
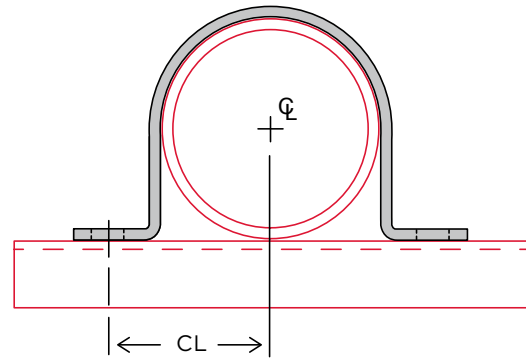


Conduit & Tubing Clamp — ZPS2

Pipe Strap

Standard finish is Electro-Galvanized (EG).

CATALOG NUMBER	WEIGHT		PIPE SIZE		HS		CL	
	lbs.		in.	mm	in.	mm	in.	mm
ZPS20050EG	0.23		½	15	⅝	7.9	1⅛	23.8
ZPS20075EG	0.26		¾	20	⅝	7.9	1⅜	25.4
ZPS20100EG	0.29		1	25	⅝	7.9	1⅝	28.6
ZPS20125EG	0.34		1¼	32	⅝	7.9	1⅞	33.3
ZPS20150EG	0.37		1½	40	⅝	7.9	1⅞	36.5
ZPS20200EG	0.92		2	50	⅞	11.1	2⅝	54.0
ZPS20250EG	1.08		2½	65	⅞	11.1	2⅞	60.3
ZPS20300EG	1.33		3	80	⅞	11.1	2⅞	68.3
ZPS20350EG	1.43		3½	90	⅞	11.1	2⅞	74.6
ZPS20400EG	1.66		4	100	⅞	14.2	3⅜	81.0
ZPS20500EG	1.95		5	125	⅞	14.2	3⅜	95.2
ZPS20600EG	2.27		6	150	⅞	14.2	4¼	107.9
ZPS20800EG	2.75		8	203	⅞	14.2	5¼	133.3
ZPS21000EG	3.43		10	254	⅞	14.2	6⅝	160.3
ZPS21200EG	3.96		12	305	⅞	14.2	7⅝	185.7

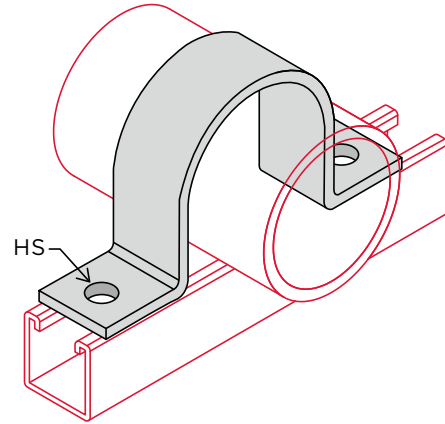

Material Specifications and Finishes

Carbon Steel — ASTM A1011-00 SS GR 33 or ASTM A1011-00CS Type B

EG — Electro-Galvanized. Electroplating deposits zinc on the surface of the steel by electrolysis from a bath of zinc salts. Recommended for relatively dry indoor use. This is the standard coating for most ZI-Strut products. Thickness of applied zinc is between 0.2 mils and 0.5 mils (5.1 µm to 12.7 µm). Coatings on ZI-Strut EG products meet ASTM B633 SC1 Type III.

HD — Hot Dip Galvanized After Fabrication. Fabricated product is dipped in molten zinc and is completely covered on all surfaces. Recommended for outdoor use. Coatings on ZI-Strut HD products meet ASTM A123/153. The zinc coating is typically 2.6 mils (66.0 µm) or 1.5 oz. per square foot (0.46 kg per square meter) per side.

S4 — 304 Stainless Steel — ASTM A240 (Type 304)

S6 — 316 Stainless Steel — ASTM A240 (Type 316)
316 Stainless Steel Nuts — ASTM A276-03

YC — Yellow Zinc Dichromate. A 0.5 mil (12.7 µm) electro-galvanized zinc plating meeting ASTM B633 SC1 Type III is applied to the surface of the metal. Yellow Dichromate is applied over the zinc. This results in a yellowish gold appearance and acts as a nonporous barrier sealant that is corrosion resistant and can be painted.

Note: Specifications subject to change without notice.

SUBMITTAL INFORMATION

PROJECT: _____ CONTRACTOR: _____ DATE: _____

ENGINEER: _____ SPECIFICATION REFERENCE: _____ SYSTEM TYPE: _____

LOCATIONS: _____ COMMENTS: _____

ZI-120523